



FIRE ALARM SYSTEM SEQUENCE OF OPERATION MATRIX														
TOWER		ALARM AT FACP AND FSA	TROUBLE AT FACP AND FSA	TOWER ALARM AT CENTRAL STATION	TROUBLE AT CENTRAL STATION	ACTIVATE HORNS & STROBES	SHUT DOWN CAB AHU	ACTIVATE STAIR PRESS. FAN	SHUTDOWN STAIR PRESS. FAN	SILENCE HORNS STROBES REMAIN ACTIVE	SILENCE INTEGRAL BUZZER ONLY	MAGNETIC DOOR RELEASE	RMM INTERFACE RELAY CONTACT CLOSURE	RMM INTERFACE RELAY CONTACT CLOSURE
	MANUAL PULL STATION													
	SMOKE/HEAT DETECTOR													
	CAB SMOKE DETECTOR													
	SMOKE DETECTOR (TOP OF STAIR)													
	FIRE ALARM TROUBLE CONDITION (OPENS, SHORTS OR GROUNDS)													
	ALARM SILENCE SWITCH AT CAB LEVEL ANNUNCIATOR													
	ALARM SILENCE AT FACP													

1 SEQUENCE OF OPERATION - FIRE ALARM SYSTEM  
F07 NOT TO SCALE

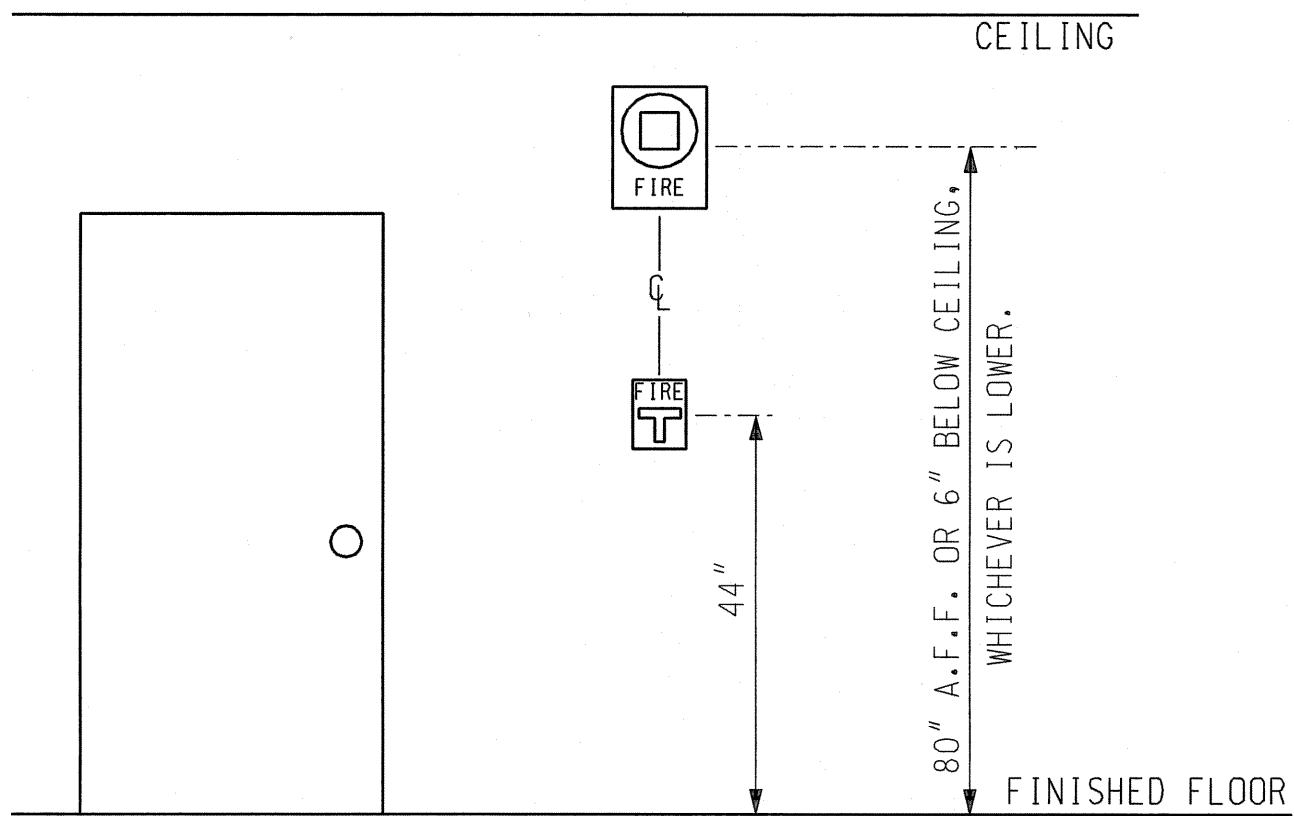

2 FIRE ALARM DEVICE ELEVATION  
F07 NOT TO SCALE

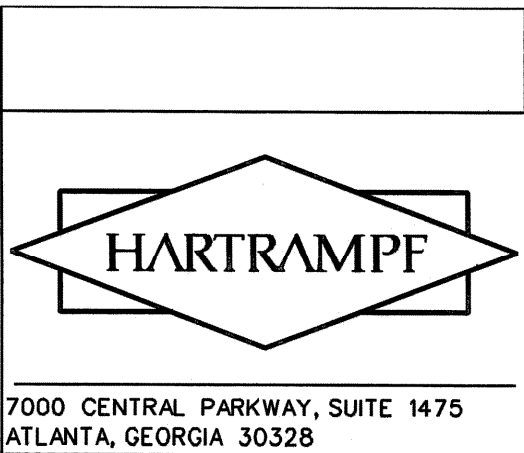

REV.	LTR.	DATE	DESCRIPTION	CHECKED	APPROVED
DEPARTMENT OF TRANSPORTATION FEDERAL AVIATION ADMINISTRATION SOUTHERN REGION ATLANTA, GEORGIA 30320					
AIRPORT TRAFFIC CONTROL TOWER (ATCT) FIRE AND LIFE SAFETY MODIFICATIONS SEQUENCE OF OPERATION FIRE ALARM SYSTEM					
JACKSON		HAWKINS FIELD		MS	
REVIEWED BY	SUBMITTED BY		APPROVED BY		
DESIGNED BY	ISSUED BY		DATE		
MAS	ATLANTA NAS IMPLEMENTATION CENTER		12-18-2006		
DRAWN BY	HJM		DRAWING NO.		
CHECKED BY	DWF		SO-D-103765-F07		